

Mid Florida Metal Roofing Supply, Inc.

Product Evaluation Report for

1" Nailstrip 24 Ga. 16" Wide over ½" Plywood

Florida Product Approval # 11671.1

Category: Roofing

Subcategory: Metal Roofing

Compliance Method: 9B-72.070(1)(d)

NON HVHZ

Engineer Evaluator:

Terrence E. Wolfe, P.E. # 44923
19530 Ramblewood Drive
Humble, TX 77338

Validator:

Locke Bowden, P.E., FL #49704
9450 Alysbury Place
Montgomery, AL 36117



Product Manufacturer:

Mid Florida Metal Roofing Supply, Inc.
27622 County Road 561
Tavares, FL 32778
352-742-7070

Product Description:

Nailstrip Panel, 24 Ga. (0.024”), 16” Pan Width, 1” Tall Rib, Snap Lock Seam, non-structural metal panel over 15/32” plywood with Grace Ice & Water Shield® adhered to plywood.

Panel Rollformer: Schlebach Quadro-Plus Rollformer
Metalforming, Inc.
100 International Drive
Peachtree City, GA 30269

Compliance Statement:

The product as described in this report has demonstrated compliance with the Florida Building Code 2007, Sections 1504.3.2.

Documentation Supporting the Compliance Statement:

The product has been tested in accordance with:

- TAS 125-03 UL 580-94 / 1897-98: Test report 72-0314T-06⁽ⁱ⁾ dated 3-24-07 by Force Engineering & Testing per
 - A) Test #1, Tested 11-20-06 Main Field over 15/32” Plywood
 - B) Test #2, Tested 11-22-06 Main Field over 15/32” Plywood
 - C) Test #3, Tested 1-22-07 Edge over 15/32” Plywood
 - D) Test #4, Tested 2-14-07 Edge over 15/32” Plywood
- TAS 100-95: Test report T158-07⁽ⁱ⁾ dated 4-5-07 by Farabaugh Engineering & Testing
Wind Driven Rain Test Results: Passed
- TAS 110-00: Valspar Fluropon® coated metal panel testing
 - A) ASTM G 26 by PRI Asphalt Technologies dated January 19, 2004 Results: Passed
 - B) ASTM B 117 by PRI Asphalt Technologies dated January 19, 2004 Results: Passed

Limitations and Conditions of use for NON HVHZ:

Maximum Roof Component Uplift Pressures:


| | |
|-----------------------------|---|
| Main Field Pressure: | -59.75 psf @ 16” O.C. fastener spacing in panel slots |
| Perimeter Pressure: | -101.0 psf @ 6 3/4” O.C. fastener spacing in panel slots |
| Corner Pressure: | -153.5 psf @ 6 3/4” O.C. fastener in slot & 12” O.C. fasteners in Pan (See Details) |

Panel Material Standards:

24 Ga., 0.024” Min, Grade 50, ASTM A792 coated with Valspar Fluropon® or ASTM A653 G90 Bare. Panel Material shall comply with FBC, Section 1507.4.3

Panel Fasteners:

See Load Table & Details. Fasteners must be Corrosion resistance per FBC, Section 1507.4.4

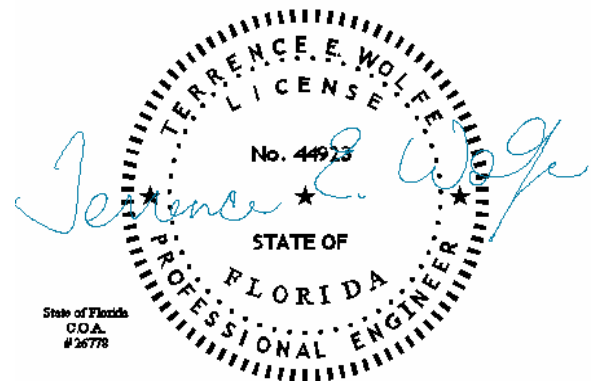

Minimum Roof Slope: 2:12. Minimum Slope shall comply with FBC 2007, Section 1507.4.2 and Manufacturers recommendations.

Substrate Description: Minimum 15/32" plywood w/ Grace Ice & Water Shield® over entire deck. Must be designed in accordance w/ FBC 2007

Moisture Barrier: Grace Ice & Water Shield® Self-Adhered Roofing Underlayment or equivalent.

Vapor Barrier: 30# Asphalt Saturated organic felt paper in compliance with ASTM D226, Type I or Type II.

Fire Barrier: (Optional) ¼" Georgia Pacific "Dens Deck" or manufacturer approved equal.

Shear Diaphragm: Shear diaphragm values are outside the scope of this report.

Design Procedure:

Based on the dimensions of the structure, appropriate wind loads are determined using Chapter 16 of the FBC 2007 for roof cladding wind loads. These component wind loads for roof cladding are compared to the allowable pressures listed above. The design professional shall select the appropriate erection details to reference in his drawings for proper fastener attachment to his structure and analyze the panel fasteners for pullout and pullover. Support framing must be in compliance with FBC Chapter 22 for steel, Chapter 23 for wood and Chapter 16 for structural loading.

Installation Requirements:

Install the panel system according to the manufacturer's installation instruction

Quality Assurance Entity:

Keystone Certifications, Inc: FBC #QUA1824

Certificate of Independence:

See uploaded attachments

Authorized Representative:

Terrence E. Wolfe, P.E. #44923

⁽ⁱ⁾ The Test Reports are owned by Metalforming, Inc. Metalforming, Inc. gives the above manufacturer permission to use these test reports.

